



BioMotion LLC
support@biomotionlabs.com


SAMPLE NAME: Bacteriostatic Water
SAMPLE CODE: YFGK-QMYZ
RECEIVED DATE: 06/16/2026
PUBLISHED DATE: 06/24/2026



DECLARED IDENTITY	Bacteriostatic Water
MATRIX TYPE:	BACTERIOSTATIC WATER
SAMPLE NAME:	Bacteriostatic Water
SAMPLE SIZE:	30 mL
LOT CODE:	ARC-BW-18

Sample	Test	Specification	Result	Status
Benzyl Alcohol Assay (HPLC)	HPLC	0.9% (v/v) $\pm$ 10%	0.92 % (v/v)	CONFORMS
Fill volume / Net content	Gravimetric	—	30.21 mL	MEASURED
pH Determination	pH	4.5 – 7.0	5.34	CONFORMS

HPLC Chromatogram Report

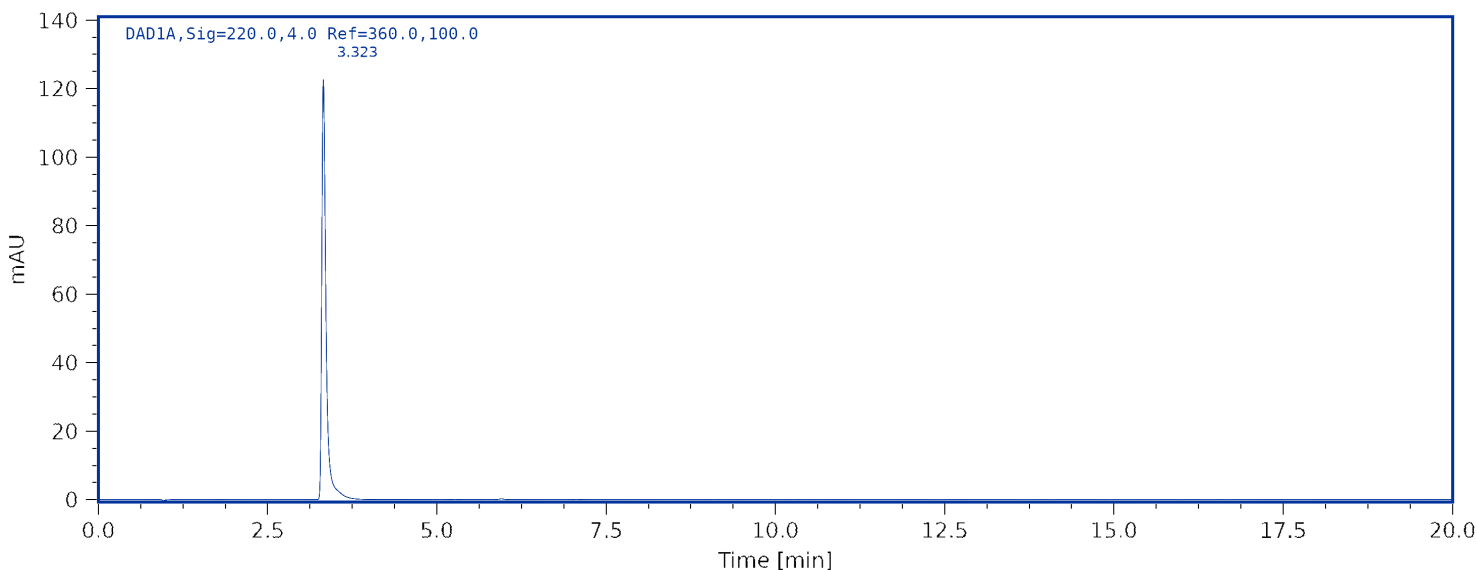

RESULTS REVIEWED BY:

Anthony Burke PhD
Lab Manager
06/24/2026

RESULTS CERTIFIED BY:

Dr. Levi Fried MD
Lab Director
06/24/2026

ACCUMARKLABS.COM
YFGK-QMYZ
06/24/2026





BioMotion LLC
support@biomotionlabs.com

SAMPLE NAME: Bacteriostatic Water
SAMPLE CODE: YFGK-QMYZ
RECEIVED DATE: 06/16/2026
PUBLISHED DATE: 06/24/2026

Sample	Test	Specification	Result	Status
Bacteriostatic Water	Endotoxin (LAL)	≤ 0.25 EU/mL	Pass	CONFORMS
Bacteriostatic Water	Rapid Sterility Screening (PCR)	Not Detected	Pass	CONFORMS

RESULTS CERTIFIED BY:

RESULTS CERTIFIED BY:


Anthony Burke PhD
Lab Manager
06/24/2026


Dr. Levi Fried MD
Lab Director
06/24/2026

ACCUMARKLABS.COM
YFGK-QMYZ
06/24/2026

